

a Neighborly™ company

## Certificate of Completion

### Overall Sealing Results

When we arrived,  
YOUR DUCTS HAD:

**501.3 CFM of Leakage**, equivalent to a  
**94.7 Square Inch Hole**


*This equals 300.8 refrigerators full of air loss every hour.*

After we finished,  
YOUR DUCTS HAVE:

**33.6 CFM of Leakage**, equivalent to a  
**6.3 Square Inch Hole**

This corresponds to a **93.3% Reduction** in  
Duct Leakage.

Note: Duct Leakage results are calculated in Cubic Feet per Minute (CFM) measured at a standard OPERATING PRESSURE of 25 Pa.

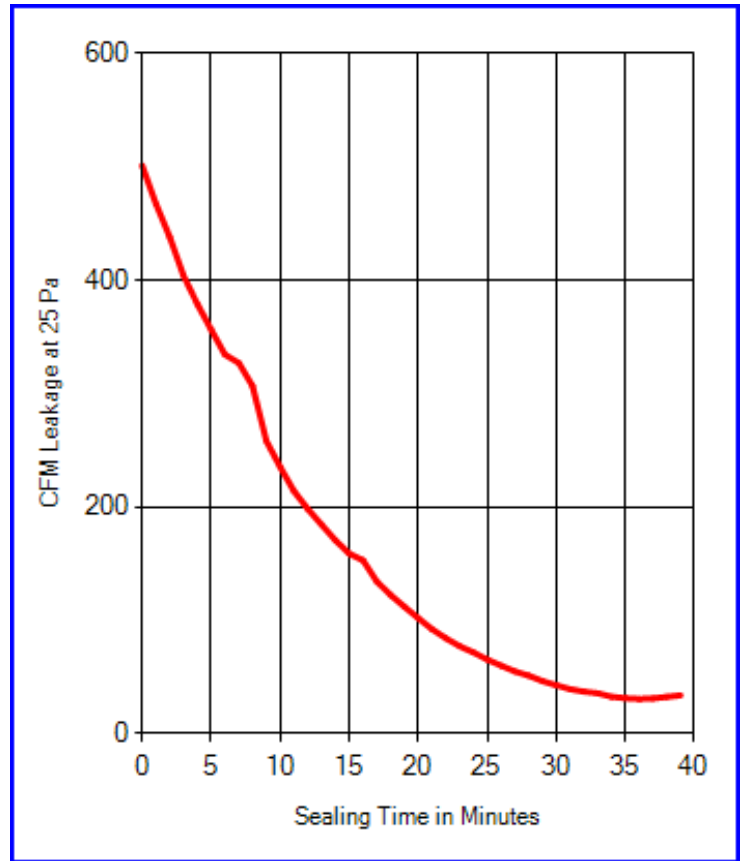

Aeroseal Technician **Oscar Solis**

Aeroseal Case ID **5202**

Date of Seal **11/13/2019**

System Description **Basement Main System**

Seal Description **Basement Ductwork**

Hardware **HomeSeal Connect**

### Duct Sealing Performed By:

Aire Serv  
223 N Royal Ave  
Front Royal, VA 22630 Phone: 540.631.9670

**AEROSEAL®**  
Duct Sealing From The Inside